


GUIDELINE FOR INSTALLING UNDERGROUND CABLE

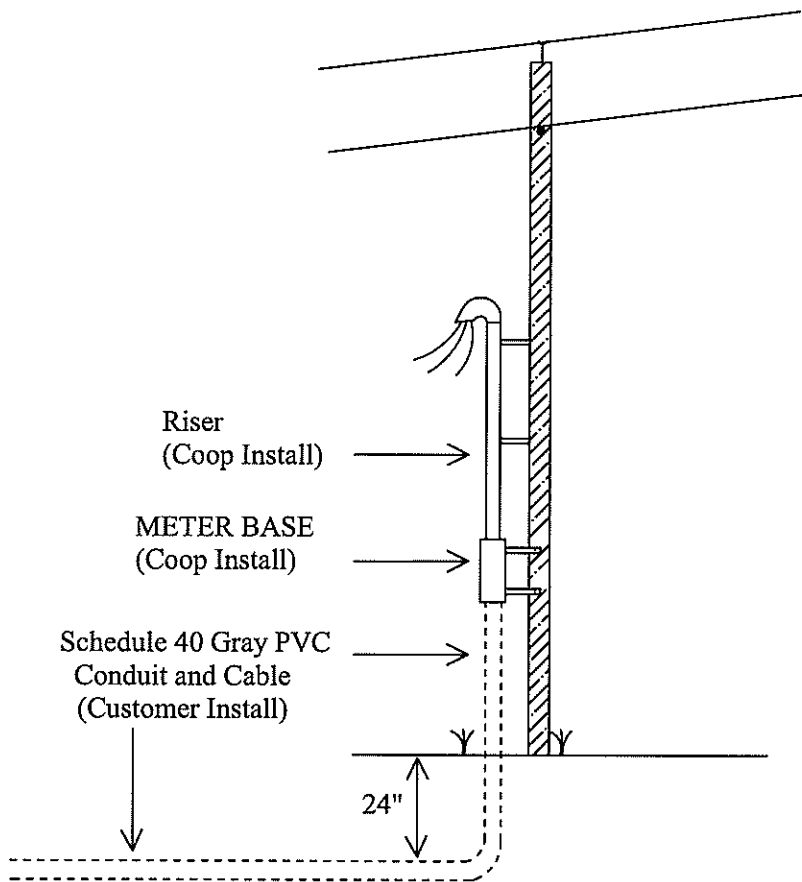

When Customer completes installing the underground cable call:
Juleann Holden
903-763-2203
Ext. 200

- 1) The Cooperative will install the meter base and riser on Cooperative pole as shown above.
- 2) The Customer is responsible for installing the underground cable and conduit from the Cooperative's meter base to their disconnect or switchbox.
- 3) The underground cable shall be in Schedule 40 Gray PVC pipe buried a minimum of 24" in depth.
- 4) The Customer is responsible for connecting the underground cable into the bottom lugs of the meter base and into their disconnect or switchbox. (Customer needs to make sure meter base is de-energized.)
- 5) The Customer is responsible for the measurement of underground cable needed.
- 6) The Customer is responsible for picking up the underground cable from the Cooperative.
- 7) Appurtenances or attachments of any kind shall not be affixed to the Cooperative poles.