


# WOOD COUNTY ELECTRIC COOPERATIVE, INC. GUIDELINE FOR UNDERGROUND M.O.P. AND V.L.

## Underground Temporary Meter Loop

The member shall be responsible for installing the underground conductor between his meter loop pole and Wood County Electric Cooperative underground meter base. (This same guideline applies to an M8-10.)

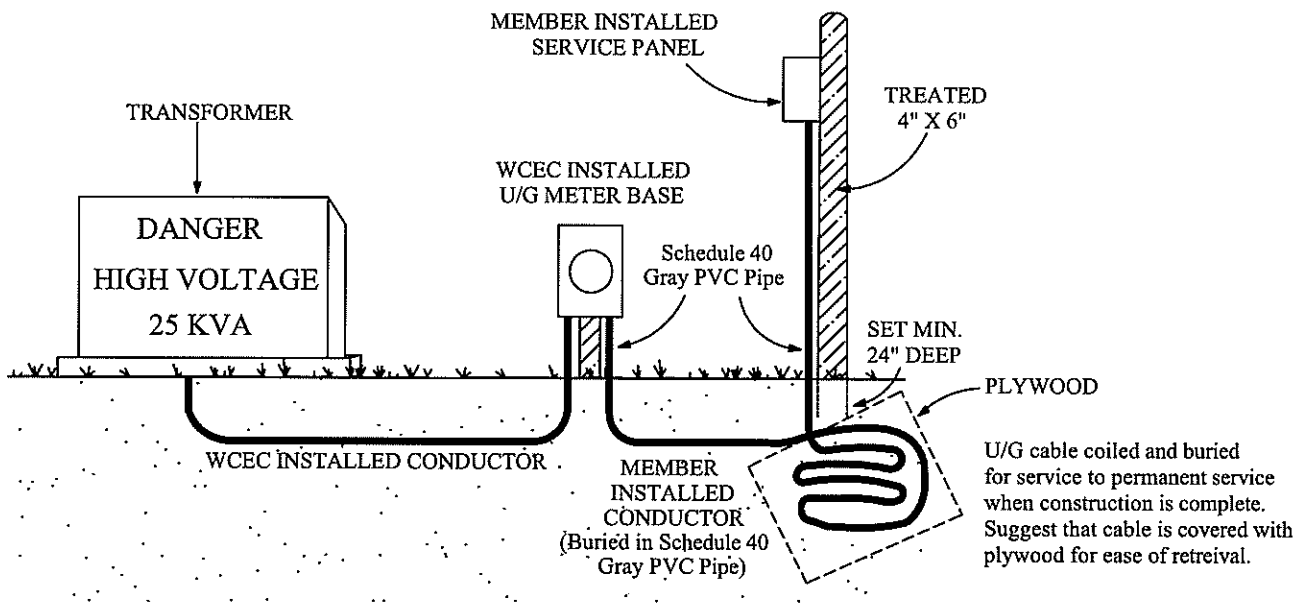

## Underground Vapor Lights

Wood County Electric Cooperative shall install the vapor light pole. The vapor light conductor shall always be connected to the Cooperative side (top) of the meter base.

